

To: All Tender Participants

Dear Sir / Madam,

**Re: Public Tender No. PD23000219 (the "Tender") –  
 Notice Regarding Submission Deadline and Clarifications**

The Company has received requests for clarifications regarding the Tender, in accordance with Section 5.1 thereof, provided below (the "Question"). Next to each Question is the Company's answer, which shall be considered by the Company as authoritative.

		<u>Question</u>	<u>Answer</u>
1	Tender documents section 3.7	Bidder must submit a valid API approval certification for the manufacturing of API-610 pumps. We manufacture and test pump according to API610 standard but has no specific certificate for it.	Manufacturer will perform all tests defined in the API 610 standard. The manufacturer will provide all test data for the customer's reference
2	Specification section 5.7	Mechanical seal: The pump shall be supplied with API 682 double type mechanical seal manufacturer by John Crane or equivalent. The mechanical seal shall be a complete unit including seal flush and external seal quench.	The pump shall be supply with "Dual Seals, Unpressurised, PLAN 52. In addition to the attached plane 52 drawing, the manufacturer shall supply the following items: <ul style="list-style-type: none"> <li>• Leak Container: Container for collecting leaks from the vent port</li> <li>• The container shall be fitted with leak detection transmitter signal to the central control room</li> <li>• The manufacture will check the possibility of not using water for cooling coils.</li> </ul>
3	Tender documents section 2.2	The Goods will be supplied DDP Ashkelon Company's warehouse (Incoterms 2010). Shipping costs may highly fluctuate during the long delivery schedule. We prefer to quote Ex-works prices instead of DDP	The request is denied



In addition, The Company has decided to extend the Submission Deadline to March 30, 2023 (the “**Extended Deadline**”).

Thank you for your continued interest in the Tender; we look forward to receiving your bids.

Sincerely,

*Talmor*

Talmor Sela

Procurement and Engagements Department






# אפי קגנובסקי הנדסה (א.ק.ה) בע"מ. EFI KAGANOWSKI ENGINEERING (E.K.E) Ltd.

Plan 52

FLOWSERVE

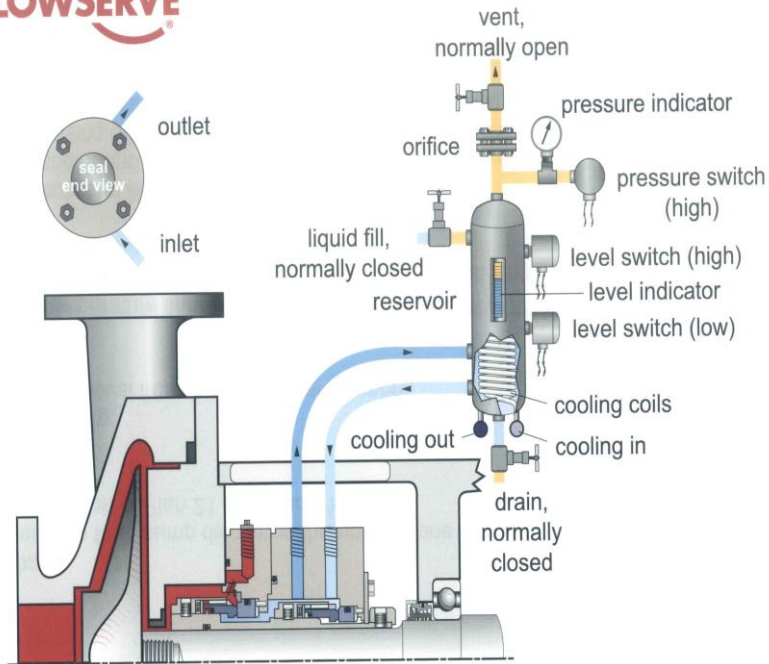

62 Sokolov street, Ramat – Hasharon.

P.O.B: 820, Even – Yehuda.

Mobil: 050-8223365 , נייד : , Fax: 03-5490905 , פקס : , Tel: 03-5495151 , טל :

דוא"ל : office@kaganowski.com

סוקולוב 62, רמת השרון.

ת.ד. : 820, אבן יהודה.

טל: 03-5495151, פקס: 03-5490905, נייד: 050-8223365

דוא"ל: office@kaganowski.com