

#244481

PETROLEUM & ENERGY INFRASTRUCTURE Ltd

T-155

Dome Roof Renovation

Billu Terminal
(Rev. P-2)

P2	5/8/2020	For Bid	E.K	E.K	
P1	6/7/2020	Preliminary	E.K	E.K	
P ⁰	7/6/2020	Preliminary	E. Kaganowski	E. Kaganowski	
REV	DATE	DESCRIPTION	BY	CKD	APPROVED
.					

EFI KAGANOWSKI engineering Ltd.
6, Weitzman Bulv'.
Ramat-Hasharon
ekaganowski@gmail.com

Scope of Works:

This document covers the technical requirements for supply and applying of sealing materials to the renovation of T-155 geodetic aluminum dome roof at Billu Terminal.

Tank Data:

Tank diameter:	48.80.
Tank high:	19.50.
Tank roof:	Aluminum, Dom Roof. Aluminum, Internal Floating Roof.
Tank Content:	Jet Fuel.

Site Conditions:

1. Site altitude is about 70 m' above sea level.
2. Ambient temperature varies between 0⁰C- 48⁰C.
3. Relative humidity varies between 40% - 95%.
4. The site is close to a corrosive industrial area.
5. Rain fall around 500 mm' / year.


Technical Request:

Current Situation:


The tank is fitted with aluminum, dome roof and internal floating roof (IFR).

Daily thermal expansion create gaps between the panels of the dome roof allows corrosive gas vapors escape from the tank and at the other hand allows water to enter the tank upon the internal floating roof.

Attached are some drawings of the dome construction as well as photos of the dome roof panel connection.

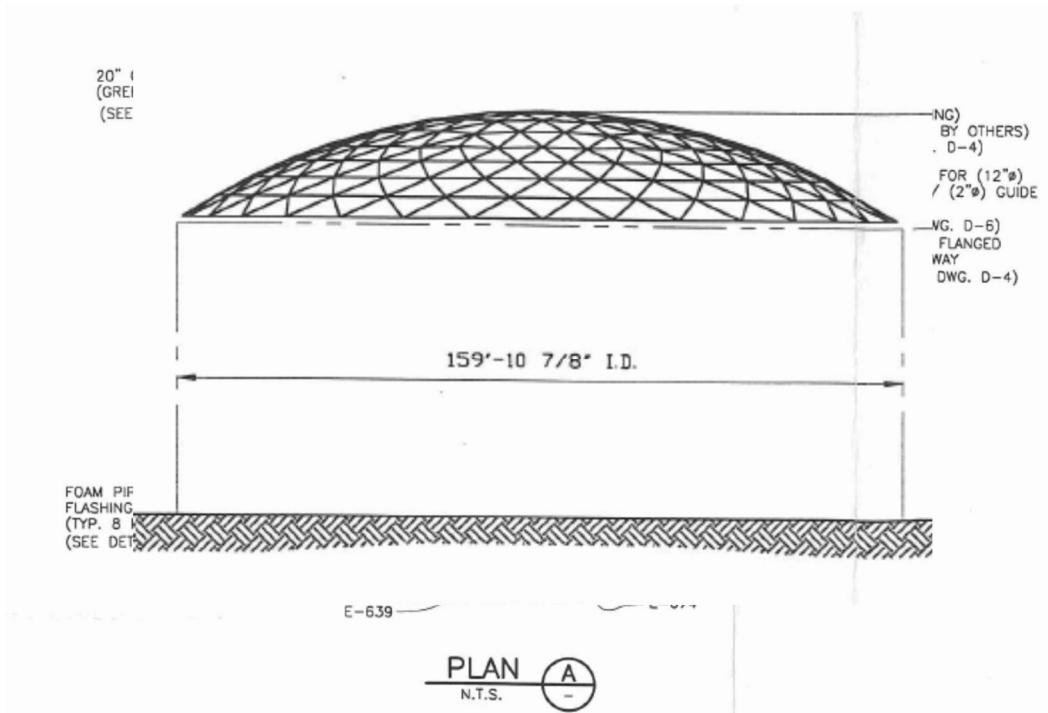

EFI KAGANOWSKI engineering Ltd.
6, Weitzman Bulv'.
Ramat-Hasharon
ekaganowski@gmail.com

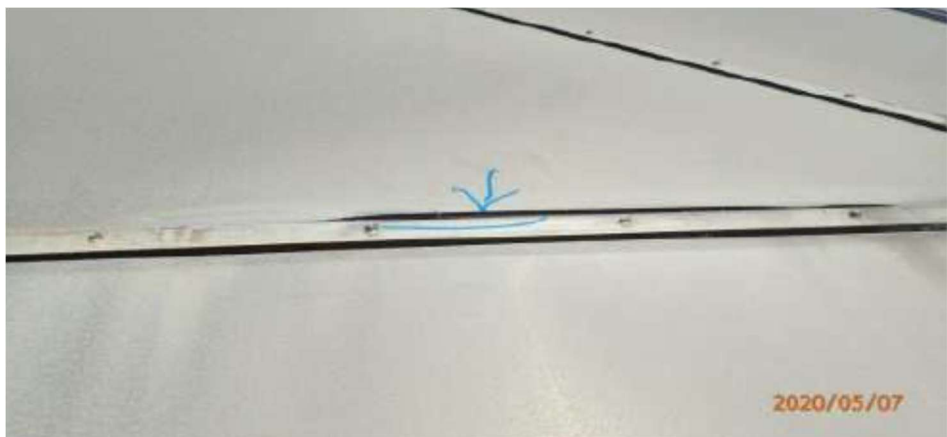

Required Solution:

The contractor shall offer solution to seal the tank roof panels by spray-applies of flexible coating system.

The contractor shall supply and applied the sealing materials directly over the dome roof panel's gaps and connections

The solution shall be chemically resistant to fuels, sulfuric acid and leachate water and the vapors that they emit.

The material shall be UV protected as well as corrosion and abrasion resistance.

The system can be applying while the tank is in service.

The system has the advantage of adhering to most properly prepared surfaces without any requiring of a primer.

The system allows a final coating thickness to be achieved in one up to two applications.

EFI KAGANOWSKI engineering Ltd.
6, Weitzman Bulv'.
Ramat-Hasharon
ekaganowski@gmail.com



The sealing system properties shall be such as describe:

- 100% solid
- No solvents and zero VOC.
- Exposure temperature: (-5) - 70°C.
- Abrasion resistance acc
ASTM D4060 1000g 1000 cycles: H-18: ~ 150 mg loss
CS-17: ~ 6 mg loss
- High elongation for bridging cracks
acc to EN 1062 B31: Passed.
- Capable of coating of all type of steel infrastructure.
- Re-coat over other polymer-based substrates and/or coatings.
- Attached are a typical physical property of the such material (the contractor may offer any similar materials):

Tensile Strength:	>27 Mpa.
Elongation:	>300%
Hardness (Shore A)	~95
Hardness (Shore D)	~50
Tear Resistance:	
ASTM D624:	64 Mpa.

Proven Experience:

The manufacturer shall quote a proven experience of applying the sealing system materials upon a fuel tank dome roof to eliminate the entering of water through the dome roof panels.

Proven Experience shall be: 5 tanks works during the last 5 years
 using the sealing systems.
 Each tank 36.6-meter diameter at least.

Manufacturer Requirements:

The material manufacture will be North American or Western European only.

The sealing material manufacturer shall provide a supervision person for overseeing and assisting with the applying of the material.

The supervision person shall be well trained with the material applying,

General Terms:

The vendor shall supply the following information:

- Sealing material specification.
- Experience approvals.
List of recommendation Customers including contact person and phone numbers or email address.
- Maintenance instruction.
- Execution period.

Guarantee:

The vendor shall guarantee the material and works for a period of 36 months from the date the works as been accomplished.

In any case of faulty works and water penetrate the dome roof upon the IFR (internal floating roof) the contractor shall fix the water penetration immediately at no additional cost to the purchaser.